
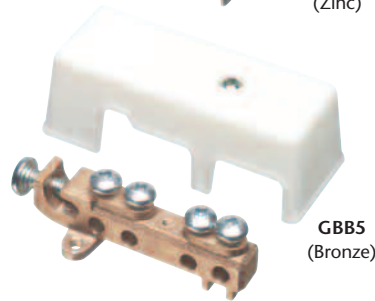
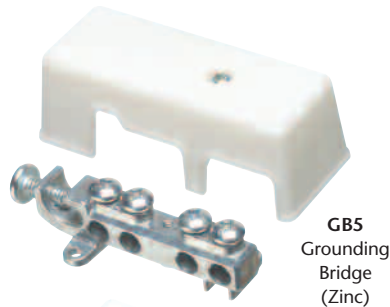


# Grounding Bridge in Zinc and Bronze

Meets 2008 NEC Ground Requirements

**NEW!**  
more on reverse

**NEW!**

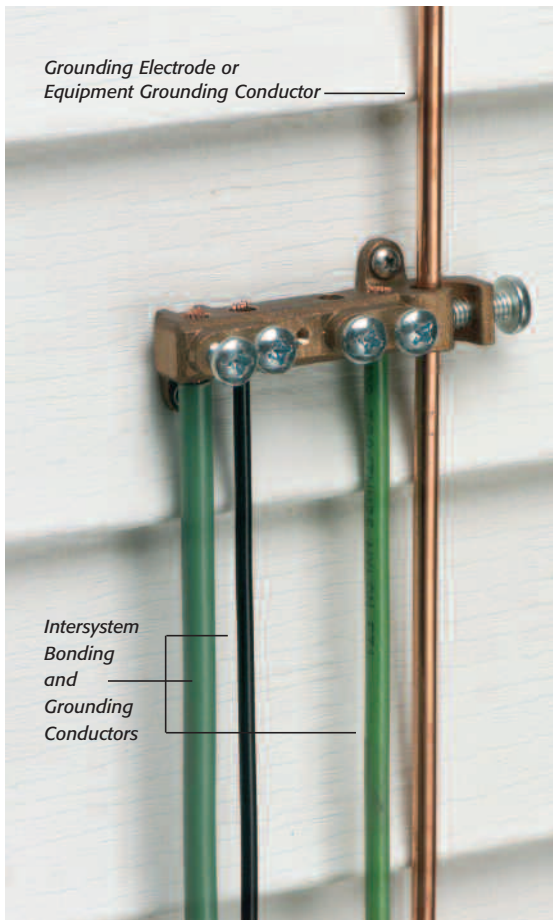

Arlington's heavy-duty Grounding Bridge provides reliable intersystem bonding between power and communication grounding systems.

They have **four** termination points; *one more than required* by 250.94 of the 2008 NEC.

Available in zinc (GB5) and bronze (GBB5 and GBB50), our new Grounding Bridge has the capacity to handle multiple hookups of communications systems; telephone, CATV or satellite dish.

- For indoor or outdoor use

- **Intersystem Bonding and Grounding Conductors:**

All accommodate #14 to #4 copper or aluminum, solid or stranded

- **Grounding Electrode Conductor or Equipment Grounding Conductor:**


GB5 and GBB5 accept #6 to #2.

GBB50 accepts #6 to #1/0. All can be used with copper or aluminum, solid or stranded.

- Fast, simple installation

- Easy access for inspections

- For good looks – textured, paintable plastic cover

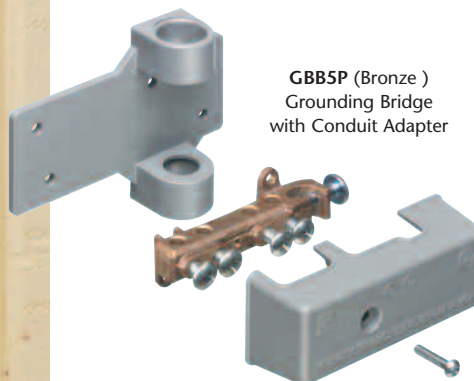

not shown  
GBB50P (bronze)  
GB5P (zinc)

**Meets NEC 2008 Ground Requirements**

Also available...Grounding Bridge in zinc and bronze, with an adapter for use with PVC conduit.



**Arlington**

1 Stauffer Industrial Park  
Scranton, PA 18517

**800/233.4717**

**Fax 570/562.0646**


[www.aifittings.com](http://www.aifittings.com)

[www.arlnew.com/gb](http://www.arlnew.com/gb)

# Grounding Bridge in Zinc and Bronze




## Intersystem Bonding Between Power & Communication Grounding Systems

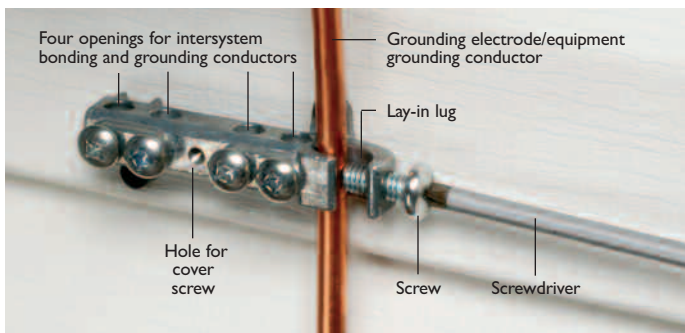


### GB5, GBB5, GBB50 Installation

- 1 Attach Grounding Bridge to surface (screws not provided).
- 2 Insert grounding electrode or equipment grounding conductor into the lay-in lug. Tighten screw.
- 3 Attach textured, paintable cover with the screw provided.
- 4 Remove cover for intersystem utilities (CATV, phone, etc). Add bonding/grounding conductors. Reinstall cover.

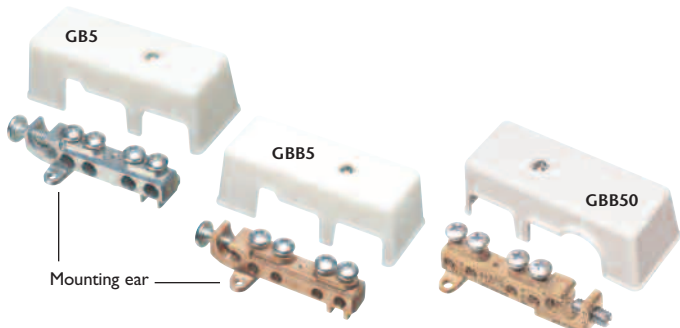

Catalog Number	UPC/DEI/NAED Mfg. #018997	Description	Grounding Electrode or Equipment Grounding Conductor	Unit Pkg	Std Pkg
GB5	76095	Zinc	#6 to #2 CU/AL	1	10
GBB5	76096	Bronze	#6 to #2 CU/AL	1	10
GBB50	09725	Bronze	#6 to #1/0 CU/AL	1	10

All handle #14 to #4 intersystem bonding/grounding conductors

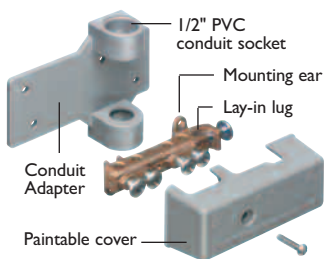

### GB5P, GBB5P, GBB50P Installation



- 1 Mount conduit adapter plate in the desired location (screws not provided). Leave hole in lower left open for #2. Install PVC conduit in adapter with PVC glue (not supplied). Install grounding electrode conductor in conduit.
- 2 Install Grounding Bridge onto grounding electrode/equipment grounding conductor using lay-in lug. Tighten screw. Using two screws (not provided), attach Grounding Bridge to structure through holes in adapter plate.
- 3 Install paintable cover.
- 4 Remove cover for intersystem utilities (CATV, phone, etc). Reinstall cover. Add bonding/grounding conductors.

Catalog Number	UPC/DEI/NAED Mfg. #018997	Description	Grounding Electrode or Equipment Grounding Conductor	Unit Pkg	Std Pkg
GB5P	09720	Zinc w/ conduit adapter	#6 to #2 CU/AL	1	10
GBB5P	09721	Bronze w/ conduit adapter	#6 to #2 CU/AL	1	10
GBB50P	09726	Bronze w/ conduit adapter	#6 to #1/0 CU/AL	1	10

All handle #14 to #4 intersystem bonding/grounding conductors



1 Stauffer Industrial Park  
Scranton, PA 18517  
**800/233.4717**  
**Fax 570/562.0646**  
[www.aifittings.com](http://www.aifittings.com)  
[www.arlnew.com/gb](http://www.arlnew.com/gb)

Patents pending  
GBs 0110/25M

Distributed by